

Technical data sheet

3-point rotary actuator with fail-safe for ball valves

- Torque motor 5 Nm
- Nominal voltage AC 100...240 V
- Control 3-point
- Deenergised closed (NC)
- · with 2 integrated auxiliary switches



Technical data

Electrical data	Nominal voltage	AC 100240 V
	Nominal voltage frequency	50/60 Hz
	Nominal voltage range	AC 198264 V
	Power consumption in operation	5 W
	Power consumption in rest position	3 W
	Power consumption for wire sizing	16 VA
	Auxiliary switch	2 x SPDT, 1 x 10% / 1 x 1190%
	Switching capacity auxiliary switch	1 mA3 A (0.5 A inductive), AC 250 V
	Connection supply / control	Cable 1 m, 4 x 0.75 mm ²
	Connection auxiliary switch	Cable 1 m, 6 x 0.75 mm ²
	Parallel operation	Yes (note the performance data)
Functional data	Torque motor	5 Nm
	Torque fail-safe	5 Nm
	Direction of motion motor	Y = 0 (A - AB = 0%)
	Direction of motion fail-safe	Deenergised NC, valve closed $(A - AB = 0\%)$
	Manual override	No
	Running time motor	35 s / 90°
	Running time fail-safe	<20 s / 90°
	Running time fail-safe note	@ -2050°C / <60 s @ -30°C
	Sound power level, motor	45 dB(A)
	Position indication	Mechanical
	Service life	Min. 60'000 fail-safe positions
Safety	Protection class IEC/EN	Il reinforced insulation
Salety		
Salety	Protection class UL	Il reinforced insulation
Salety		
Salety	Protection class UL	Il reinforced insulation
Salety	Protection class UL Protection class auxiliary switch IEC/EN	II reinforced insulation II reinforced insulation IP54 NEMA 2
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2-
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch Control pollution degree	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1.02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV 3
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch Control pollution degree Ambient temperature	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV 3 -3050°C
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch Control pollution degree Ambient temperature Storage temperature	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV 3 -3050°C -4080°C
Salety	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch Control pollution degree Ambient temperature Storage temperature Ambient humidity	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV 3 -3050°C -4080°C Max. 95% r.H., non-condensing
Weight	Protection class UL Protection class auxiliary switch IEC/EN Degree of protection IEC/EN Degree of protection NEMA/UL Enclosure EMC Low voltage directive Certification IEC/EN Certification UL Certification UL note Mode of operation Rated impulse voltage supply / control Rated impulse voltage auxiliary switch Control pollution degree Ambient temperature Storage temperature	II reinforced insulation II reinforced insulation IP54 NEMA 2 UL Enclosure Type 2 CE according to 2014/30/EU CE according to 2014/35/EU IEC/EN 60730-1 and IEC/EN 60730-2-14 cULus according to UL60730-1A, UL60730-2- 14 and CAN/CSA E60730-1:02 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case Type 1.AA.B 2.5 kV 2.5 kV 3 -3050°C -4080°C

Rotary actuator fail-safe, 3-point, AC 100...240 V, 5 Nm, with 2 integrated auxiliary switches



Safety notes				
$\underline{\wedge}$	 This device has been designed for use in stationary heating, ventilation and air- conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport. 			
	 Outdoor application: only possible in case that no (sea) water, snow, ice, insolation or aggressive gases interfere directly with the actuator and that is ensured that the ambient conditions remain at any time within the thresholds according to the data sheet. 			
	Caution: Power supply voltage!			
	 Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation. 			
	 The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user. 			
	 Cables must not be removed from the device. 			
	 The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed. 			
	 The two switches integrated in the actuator are to be operated either on power supply voltage or at safety extra-low voltage. The combination power supply voltage/ safety extra-low voltage is not permitted. 			
Product features				
Mode of operation	The actuator moves the valve to the operating position at the same time as tensioning the return spring. The valve is turned back to the fail-safe position by spring force when the supply voltage is interrupted.			
Simple direct mounting	Simple direct mounting on the ball valve with only one screw. The mounting orientation in relation to the ball valve can be selected in 90° steps.			
Adjustable angle of rotation	Adjustable angle of rotation with mechanical end stops.			
High functional reliability	The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.			
Flexible signalization	The actuator has one auxiliary switch with a fixed setting and one adjustable auxiliary switch. They permit a 10% or 1190% angle of rotation to be signaled.			

Electrical installation		
$\underline{\wedge}$	Notes	 Caution: Power supply voltage! Parallel connection of other actuators possible. Observe the performance data.


Wiring diagrams

Rotary actuator fail-safe, 3-point, AC 100...240 V, 5 Nm, with 2 integrated auxiliary switches




Electrical installation



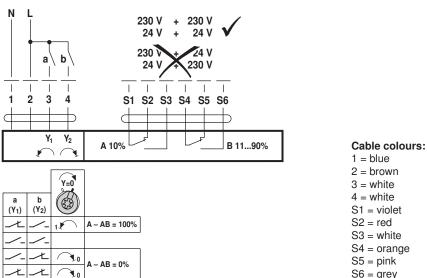

Operating controls and indicators

Auxiliary switch settings

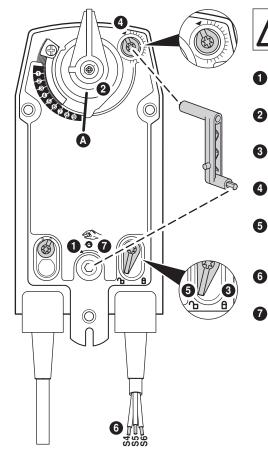

2 = brown3 = white 4 = white S1 = violet S2 = redS3 = white S4 = orange S5 = pinkS6 = grey

Note: Perform settings on the actuator only in deenergised state.

Manual override 0

Turn the hand crank until the desired switching position is set.

Spindle clamp

Edge line (A) displays the desired switching position of the actuator on the scale.

3 Fasten the locking device

Turn the locking switch to the "Locked padlock" symbol.

4 Auxiliary switch

Turn rotary knob until the notch points to the arrow symbol.

Unlock the locking device 5

Turn the locking switch to the "Unlocked padlock" symbol or unlock with the hand crank.

Cable 6

Connect continuity tester to S4 + S5 or to S4 + S6.


Manual override 0

Turn the hand crank until the desired switching position is set and check whether the continuity tester shows the switching point.



Dimensions [mm]

Dimensional drawings

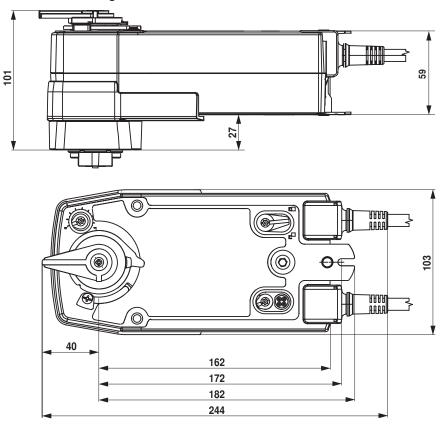

Further documentation

- The complete product range for water applications
- Data sheets for ball valves
- · Installation instructions for actuators and/or ball valves
- General notes for project planning